



# **Temporary Repairs**

## **Pronto Recordkeeping Section**

### **Question 15**

# Temporary Repairs

## 1. Pronto Recordkeeping Section

- Question 15: Are temporary repairs installed at this location?
- Guidance:
  - (1) Inspect pole, its equipment, and associated spans looking for any temp-repairs.
  - (2) When a Temp-Repair is observed answer “Yes”; otherwise, answer “No”.
  - (3) Examples of temp-repairs are documented in the Temp-Repair Job Aid.

## 2. Temp-Repairs to be Inventoried

- Rope, Duct tape, or Electric tape used to secure structure, components or conductor
- Cutout bracket on end of a crossarm to prevent crossarm from splitting
- Crossarms used to reinforce pole damage
- Insulator moved into adjacent pin due to cross-arm damage



## Temporary Repairs

## Pronto Record-Keeping

## Question 15

**15.** Are temporary repairs installed at this location? (Guidance: (1) Inspect pole, its equipment, and associated spans looking for any temp-repairs. (2) When a Temp-Repair is observed answer "Yes"; otherwise, answer "No". (3) Examples of temp-repairs are documented in the Temp-Repair Job Aid.)\*

Yes No

**15a** Does this location have an open EC tag in the Inspect App?\*

Yes No

Enter open EC Notification Number

**15a-1** If Yes, Enter the open EC Notification number\*

Tap to type answer

**15b.** Please identify the Temporary Repairs observed at this location (Select All that apply)\*

1. Rope, Duct tape, or Electric tape used to secure structure, components or conductor ☐
2. Cutout bracket on end of a crossarm to prevent crossarm from splitting ☐
3. Crossarms used to reinforce pole damage ☐
4. Insulator moved into adjacent pin due to cross-arm damage ☐
5. Other: Describe in the Comments section below ☐

Tap to type answer

**15c** Attach Photos\*


Tap to choose photo

**Comments**

Tap to type answer

## Temporary Repairs

**Example: Rope, Duct tape, or Electric tape used to secure structure, components or conductor**

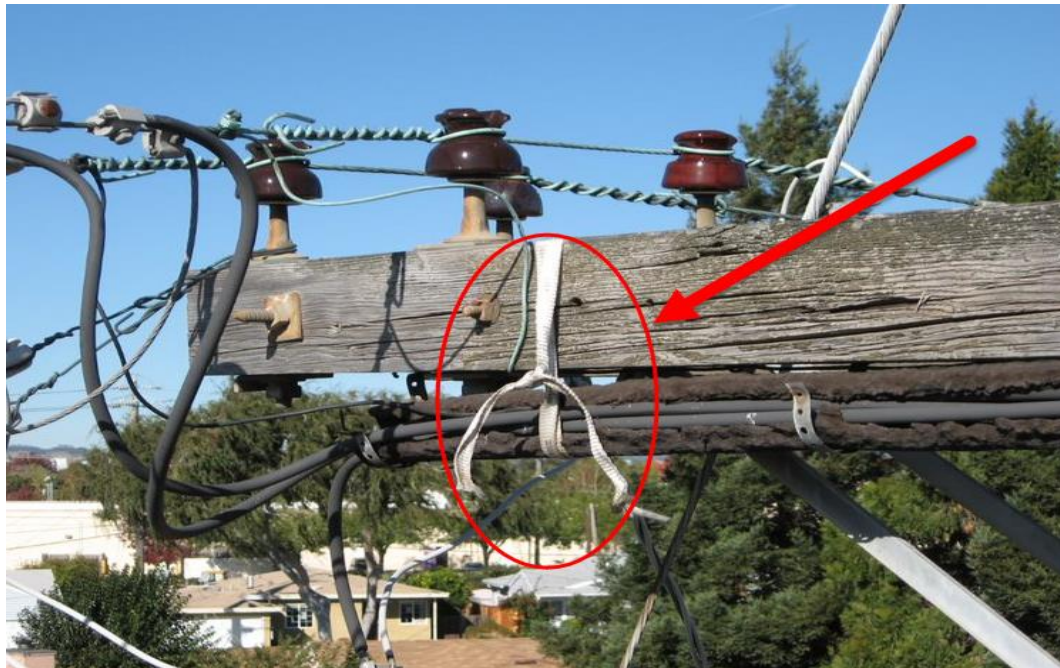

## Temporary Repairs

**Examples: Crossarms used  
to reinforce pole damage**





## Temporary Repairs

### Examples **NOT** considered Temp Repairs

1. Periscope extension on customer's weather-head.
2. The use of hardware by communication (cable/phone) to secure future third-party/communication level installations/repair work.
3. Animal mitigation like plastic wrap to prevent damage caused by squirrels when bucket-truck accessible.
4. PG&E Pole Test & Treat team may attach steel pole stubs bringing pole to standard (this is acceptable and not considered a temp-repair).
5. PG&E's Construction team may attach wood pole stubs bringing pole to standard.
6. Service wire section replaced midspan.
7. Repair/Construction work is in progress.

